

# SmartLink

---

Dosatron's SmartLink software is used to analyse the treatment data recorded by the SmartDosing system on a PC or MAC.

Discover and learn how to use the main features of SmartLink with this tutorial.

## FIRST USE IMPORTING DATA

If your SmartDosing is not connected to your computer with the cable provided, you will need to download your treatments to the USB stick provided.

Insert the USB key into the computer's USB port.



**End-User Licence Agreement**

English ▾

A Simplified Joint Stock Company, registered with the Trade and Companies Register of Bordeaux under the number 418 828 822, and having its registered offices at Rue Pascal, 33370 TRESSES, (hereinafter referred to as « Dosatron International S.A.S. ») makes available to software users (hereinafter referred to as the « User »), a software called « Dosatron Smart Dosing software » (hereinafter referred to as the « Software »).

The purpose of these Terms and Conditions of Use for the Software (hereinafter referred to as the « Terms and Conditions of Use ») is to set out the terms and conditions of use of the Software by the User and Dosatron International's liabilities during normal use of the Software by the User. Normal use of the software (hereinafter referred to as the « Use »), means access to the Software and the use of its functionalities, under the conditions set out in the Terms and Conditions of Use.

By using the Software in any manner whatsoever, the User acknowledges that they are bound by these Terms and Conditions of Use.

Limits of liability

I accept the terms of use

When using it for the first time, choose the language, read and accept the general terms and conditions of use.

First use ? Import your SmartDosing data.

### End-User Licence Agreement

English ▾

A Simplified Joint Stock Company, registered with the Trade and Companies Register of Bordeaux under the number 418 828 822, and having its registered offices at Rue Pascal, 33370 TRESSES, (hereinafter referred to as « Dosatron International S.A.S. ») makes available to software users (hereinafter referred to as the « User »), a software called « Dosatron Smart Dosing software » (hereinafter referred to as the « Software »).

The purpose of these Terms and Conditions of Use for the Software (hereinafter referred to as the « Terms and Conditions of Use ») is to set out the terms and conditions of use of the Software by the User and Dosatron International's liabilities during normal use of the Software by the User. Normal use of the software (hereinafter referred to as the « Use »), means access to the Software and the use of its functionalities, under the conditions set out in these Terms and Conditions of Use.

By using the Software in any manner whatsoever, the User acknowledges that they are bound by these Terms and Conditions of Use.

Limits of liability

I accept the terms of use



Click on OK.

### End-User Licence Agreement

English ▾


A Simplified Joint Stock Company, registered with the Trade and Companies Register of Bordeaux under the number 418 828 822, and having its registered offices at Rue Pascal, 33370 TRESSES, (hereinafter referred to as « Dosatron International S.A.S. ») makes available to software users (hereinafter referred to as the « User »), a software called « Dosatron Smart Dosing software » (hereinafter referred to as the « Software »).

The purpose of these Terms and Conditions of Use for the Software (hereinafter referred to as the « Terms and Conditions of Use ») is to set out the terms and conditions of use of the Software by the User and Dosatron International's liabilities during normal use of the Software by the User. Normal use of the software (hereinafter referred to as the « Use »), means access to the Software and the use of its functionalities, under the conditions set out in these Terms and Conditions of Use.

By using the Software in any manner whatsoever, the User acknowledges that they are bound by these Terms and Conditions of Use.

Limits of liability

I accept the terms of use



First use ? Import your SmartDosing data.

First use ? Import your SmartDosing data.

Click on Import.



Click on "Choose directory" to pick the directory containing the data of your USB Key.

Choose directory

Import

Click on "Choose directory" to pick the directory containing the data of your USB Key.



Click on "Choose directory" to pick the directory containing the data of your USB Key.

Choose directory /Users/Pierre/Desktop/SMARTLINK APPLICATION/Fichiers logs/Demo

Import

Click on Import.

/SMARTLINK APPLICATION/Fichiers logs/Demo

Import

In the USB stick tree, select the Log file and click OK.

Click on "Choose directory" to pick the directory containing the data of your USB Key.

Choose directory

/Users/Pierre/Desktop/SMARTLINK APPLICATION

Import

SmartDosing Import

2 SmartDosing detected !

Importing SmartDosing

New SmartDosing detected : M16260003 pig

Please define a name for your SmartDosing

New SmartDosing detected : M16260004 poultry

Please define a name for your SmartDosing

Save



Enter a name for this SmartDosing device and click on SAVE.

# DASHBOARD

The dashboard is displayed on the SmartLink software's home screen. For each selected SmartDosing device, the SmartLink dashboard will provide a visual and accessible summary of all the recorded data.



Operating statistics (since installation)

Installation date	2018/03/10
Running duration	21 days 02:41:01
Total water volume	5998.69L
Total treatment volume	529.99L
Temperature range	20°C - 20°C
Latest maintenance	2018/04/03

SmartDosing Firmware

Current version **M25AL5 V2.9.4.4**

5 latest alarms

**No water supply** 2018/08/27


5 latest events

- Diagnosis 2018/09/10
- Preventive maintenance 2018/09/09

Dosing pump monitoring

SEPTEMBER 2018


today < >

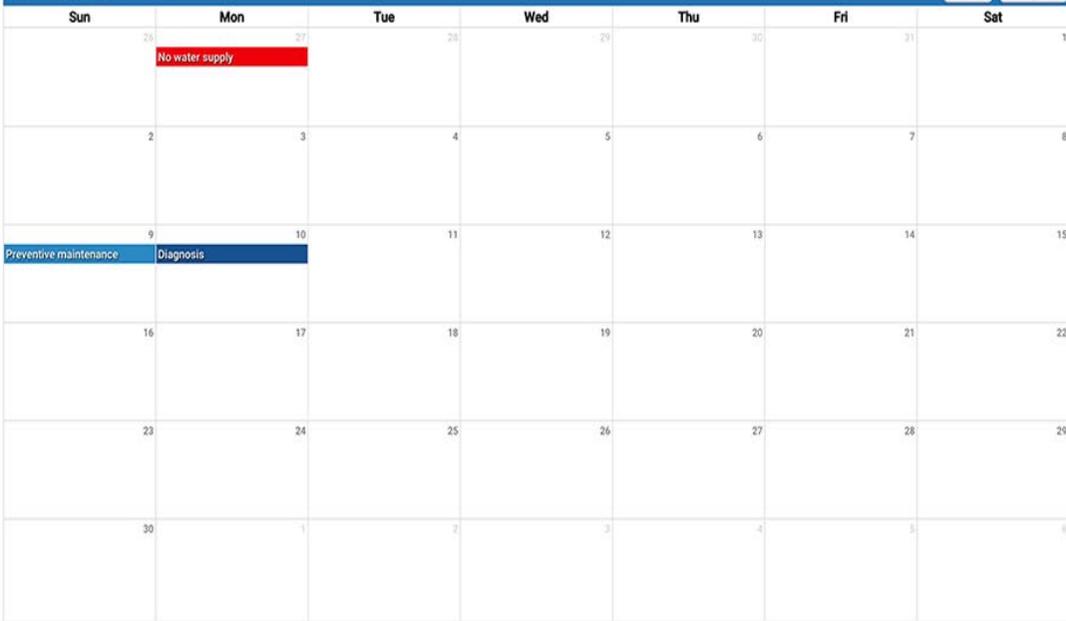

Treatment monitoring

SEPTEMBER 2018

today < >

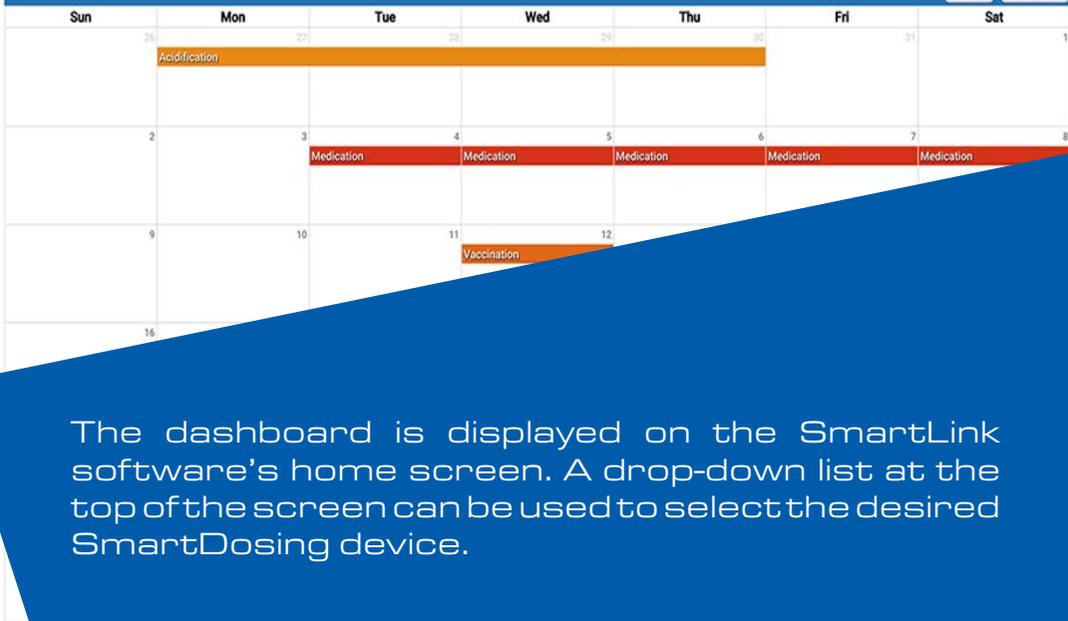

The dashboard is displayed on the SmartLink software's home screen. A drop-down list at the top of the screen can be used to select the desired SmartDosing device.


## Operating statistics (since installation)

🕒 Installation date	2018/03/10
🕒 Running duration	21 days 02:41:01
💧 Total water volume	5998.69L
🧪 Total treatment volume	529.99L
🌡️ Temperature range	20°C - 20°C
🕒 Latest maintenance	2018/04/03

## SmartDosing Firmware

Current version	M25AL5 V2.9.4.4
-----------------	-----------------

## Dosing pump monitoring

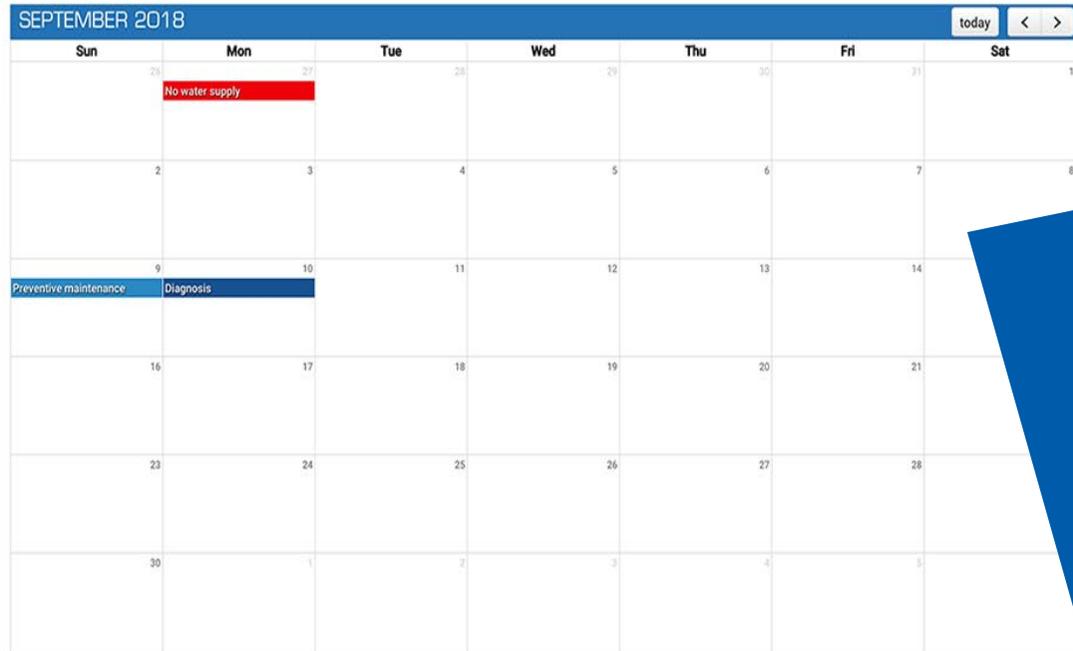


## 5 latest alarms

🔴 No water supply 2018/08/27

## 5 latest events

🔵 Diagnosis 2018/09/10  
 🔵 Preventive maintenance 2018/09/09

## Treatment monitoring

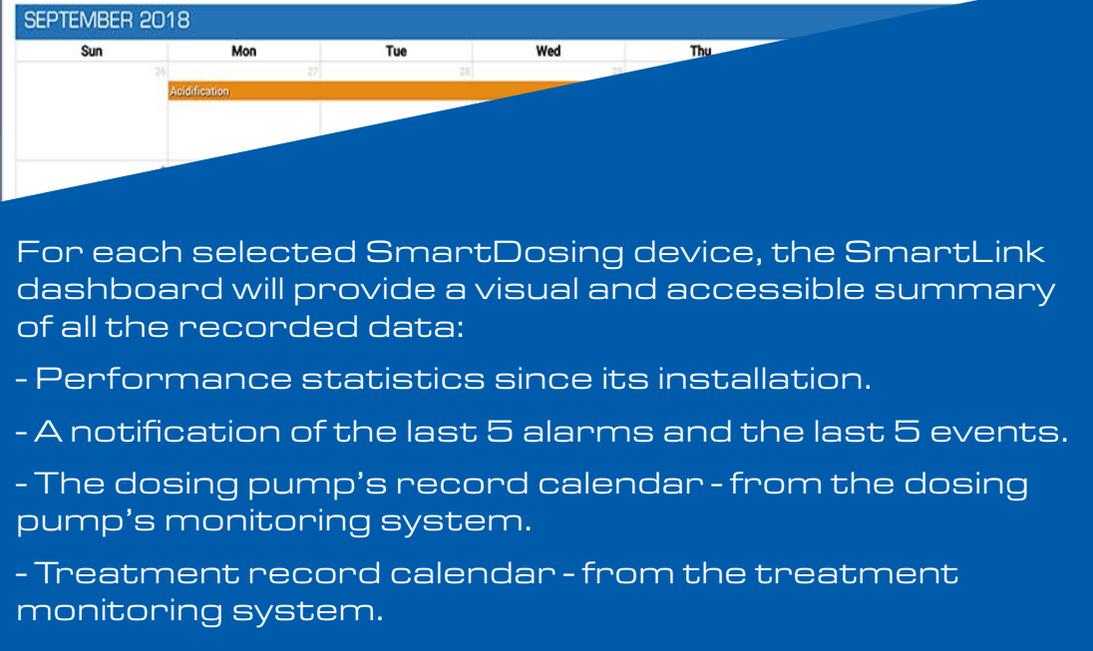

For each selected SmartDosing device, the SmartLink dashboard will provide a visual and accessible summary of all the recorded data:

- Performance statistics since its installation.
- A notification of the last 5 alarms and the last 5 events.
- The dosing pump's record calendar - from the dosing pump's monitoring system.
- Treatment record calendar - from the treatment monitoring system.



- Dashboard
- Dosing pump monitoring
- Treatment monitoring
- Advanced search
- Data import (USB)
- Your SmartDosing
- Configuration

Calculators

- Poultry medication calculator
- Pig medication calculator

About  
End-User Licence Agreement

2018/03/10
21 days 02:41:01
5998.69L
529.99L
20°C - 20°C
2018/04/03

M25AL5 V2.9.4.4

5 latest alarms


● No water supply 2018/08/27

5 latest events

- Diagnosis 2018/09/10
- Preventive maintenance 2018/09/09

Treatment monitoring

SEPTEMBER 2018

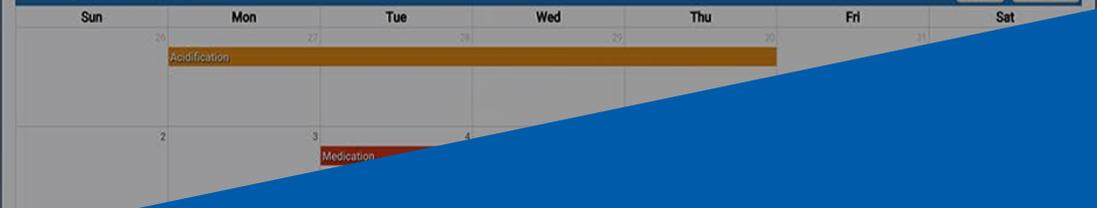

All of these functions are available in the dashboard's left side-menu, by clicking on "Main Menu".

# DOSING PUMP MONITORING





- Dashboard
- Dosing pump monitoring
- Treatment monitoring
- Advanced search
- Data import (USB)
- Your SmartDosing
- Configuration

- Calculators
- Poultry medication calculator
  - Pig medication calculator
- About  
End-User Licence Agreement

© DOSATRON INTERNATIONAL S.A.S 2019 Dosatron

2018/03/10
21 days 02:41:01
5998.69L
529.99L
20°C - 20°C
2018/04/03

M25AL5 V2.9.4.4

5 latest alarms

No water supply 2018/08/27



5 latest events

Diagnosis 2018/09/10

Preventive maintenance 2018/09/09

Treatment monitoring

SEPTEMBER 2018

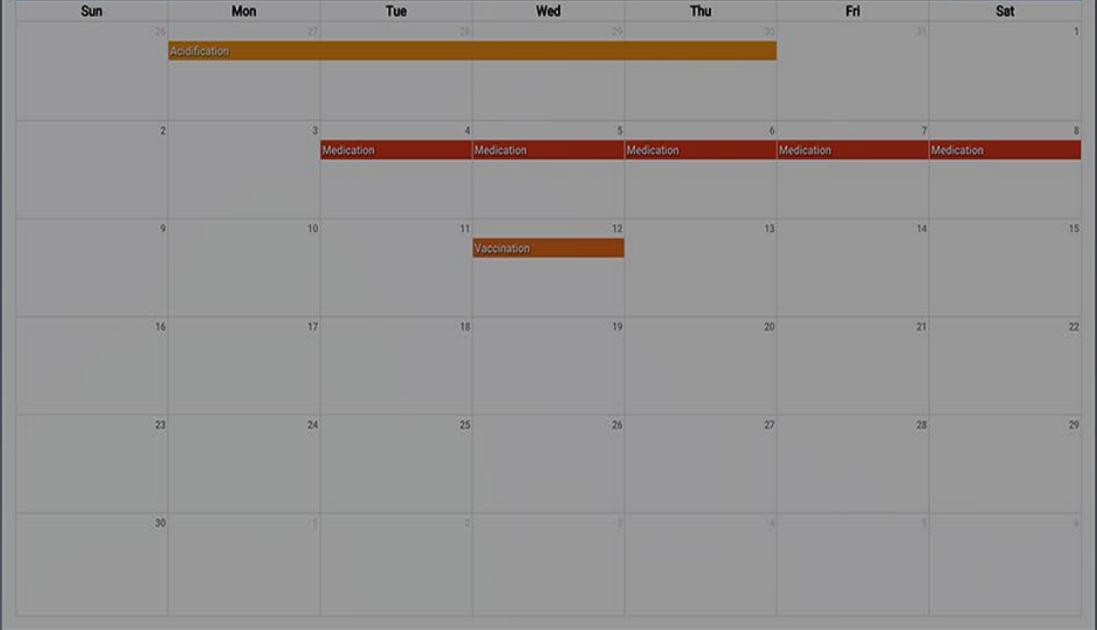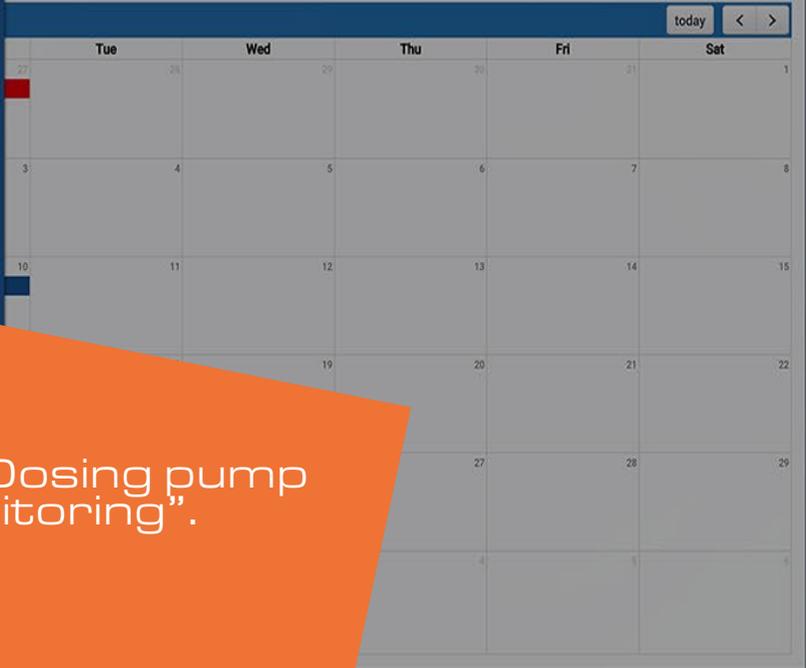

Select "Dosing pump monitoring".

September 2018

today < > Month Week Day



- Alarms
  - Overflow
  - Backflow
  - Motor stopped
  - Low battery
  - Suction failure
  - No water supply
  - Multiple alarms
- Events
  - Diagnosis
  - Preventive maintenance

Sun	Mon	Tue	Wed	Thu	Fri	Sat
	26 09:35 No water supply	27	28	29	30	31
2	3	4	5	6	7	8
9 07:43 Preventive maintenance	10 10:55 Diagnosis	11	12	13	14	15
16	17	18	19	20		
23	24					
30	1					

The calendar will automatically display the calendar month in which the last events or alarms were recorded. The event type is identified using colour coding.

September 2018

today < > Month Week Day



- Alarms
  - Overflow
  - Backflow
  - Motor stopped
  - Low battery
  - Suction failure
  - No water supply
  - Multiple alarms
- Events
  - Diagnosis
  - Preventive maintenance

Sun	Mon	Tue	Wed	Thu	Fri	Sat
26	27	28	29	30	31	1
	09:35 No water supply					
2	3	4	5	6	7	8
9	10	11	12	13	14	15
07:43 Preventive maintenance	10:55 Diagnosis					
16	17	18	19	20	21	22
23	24	25	26	27	28	29
			3	4	5	6



Click on an event to see more details.

September 2018

- Alarms
  - Overflow
  - Backflow
  - Motor stopped
  - Low battery
  - Suction failure
  - No water supply
  - Multiple alarms
- Events
  - Diagnosis
  - Preventive maintenance

Sun	Mon	Tue	Wed	Thu	Fri	Sat
	26	27	28	29	30	31
	09:35 No water supply					
2	3	4	5	6	7	8
9	10	11	12	13	14	15
07:43 Preventive maintenance	10:55 Diagnosis					
16	17	18	19	20		
23	24					
30	1					

**No water supply**

Date: 2018/08/27 - 09:36:00

Détails:

Possible cause(s):

- no water consumption on the part of the animals
- valves closed
- filter clogged
- interruption to the water supply

Close

This information provides you with an indication of the possible causes of the selected event.

# TREATMENT MONITORING





- Dashboard
- Dosing pump monitoring
- Treatment monitoring
- Advanced search
- Data import (USB)
- Your SmartDosing
- Configuration


Calculators

- Poultry medication calculator
- Pig medication calculator

About  
End-User Licence Agreement

2018/03/10
21 days 02:41:01
5998.69L
529.99L
20°C - 20°C
2018/04/03

M25AL5 V2.9.4.4

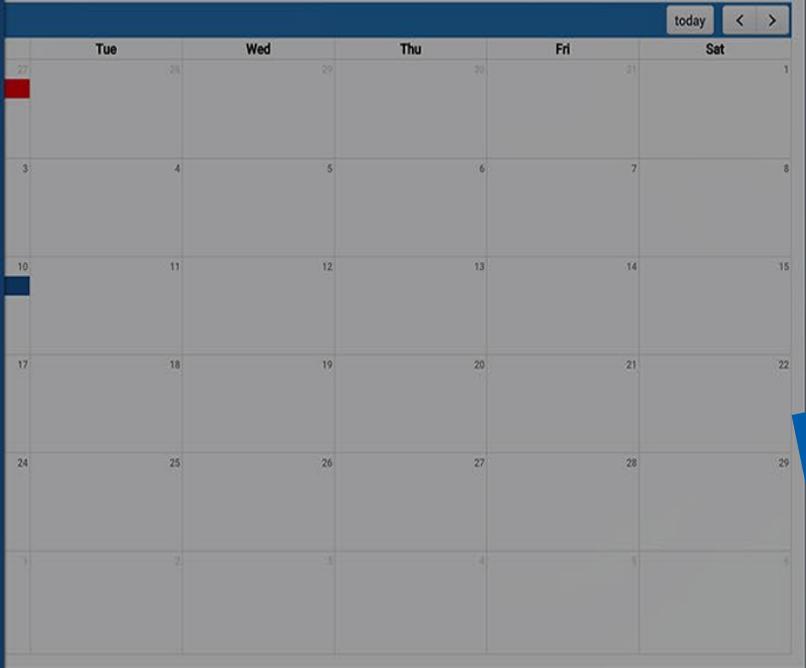

5 latest alarms


- No water supply 2018/08/27

5 latest events

- Diagnosis 2018/09/10
- Preventive maintenance 2018/09/09



Treatment monitoring

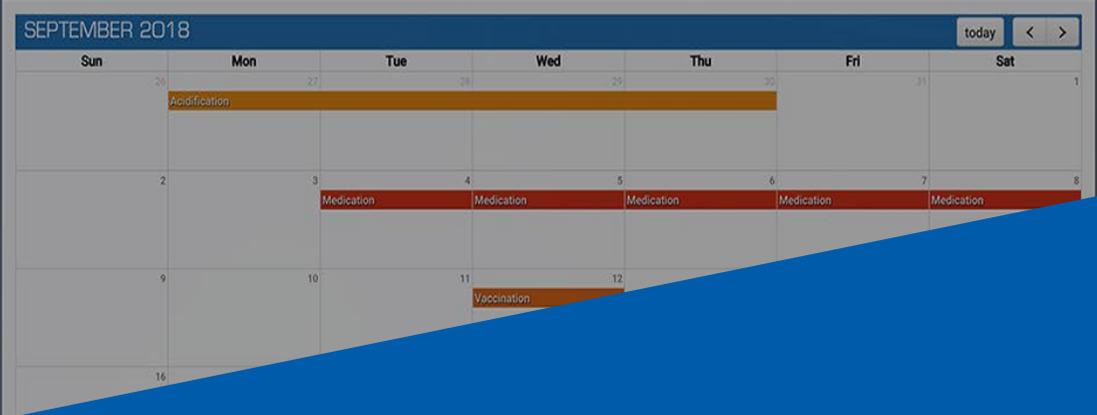

Information concerning the treatment's monitoring system can be accessed from the left side-menu, by clicking on "Main Menu".



- Dashboard
- Dosing pump monitoring
- Treatment monitoring
- Advanced search
- Data import (USB)
- Your SmartDosing
- Configuration

- Calculators
- Poultry medication calculator
  - Pig medication calculator
- About  
End-User Licence Agreement

© DOSATRON INTERNATIONAL S.A.S 2019 Dosatron

2018/03/10
21 days 02:41:01
5998.69L
529.99L
20°C - 20°C
2018/04/03

M25AL5 V2.9.4.4

5 latest alarms

No water supply 2018/08/27



5 latest events

Diagnosis 2018/09/10

Preventive maintenance 2018/09/09

Treatment monitoring

SEPTEMBER 2018

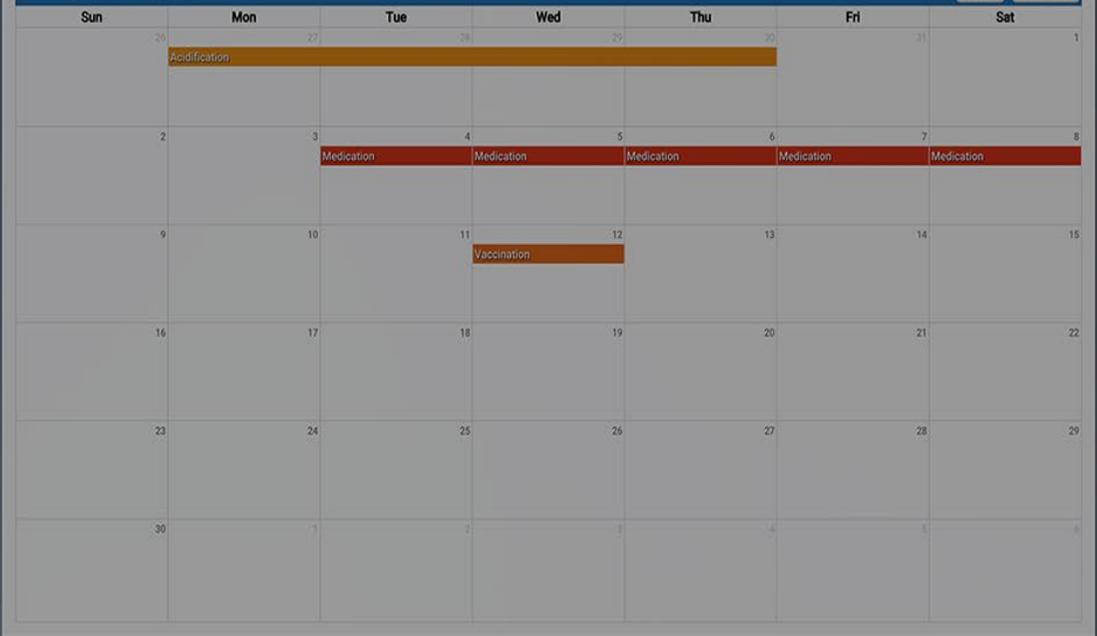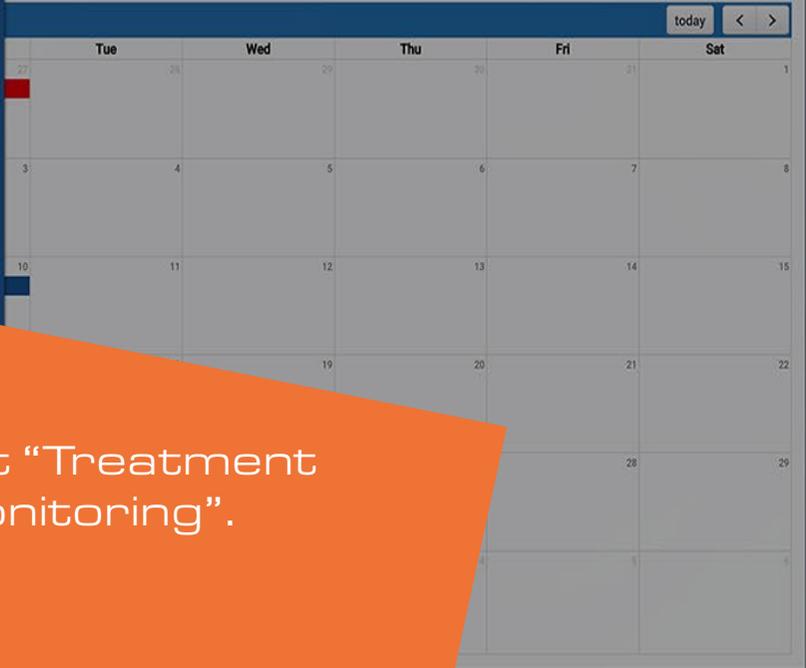


Select "Treatment monitoring".

September 2018

today &lt; &gt; Month Week Day

## Treatments

- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

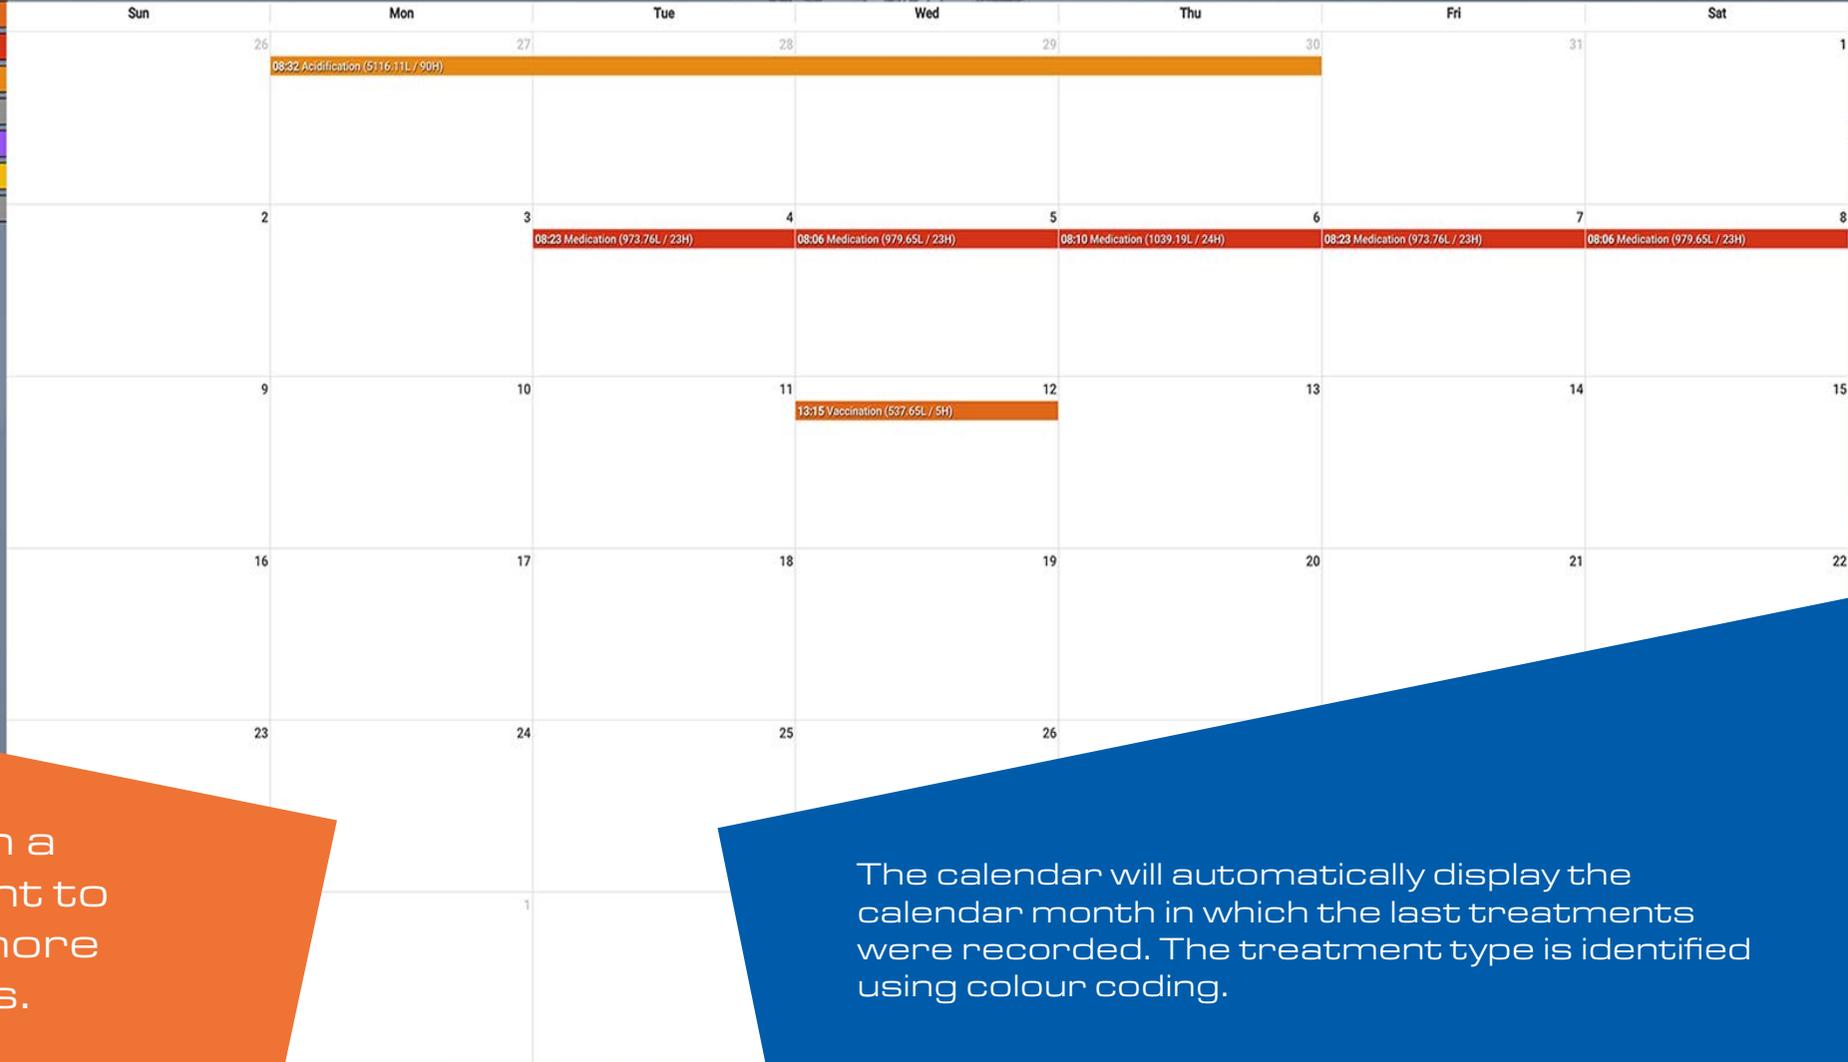

Click on a treatment to display more details.

The calendar will automatically display the calendar month in which the last treatments were recorded. The treatment type is identified using colour coding.

## Treatments

- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

Animals treated

porcine

Farmer reference


Animals treated

Treatment

SmartDosing M16260003 pig

Drinking water volume during the treatment

60 minutes

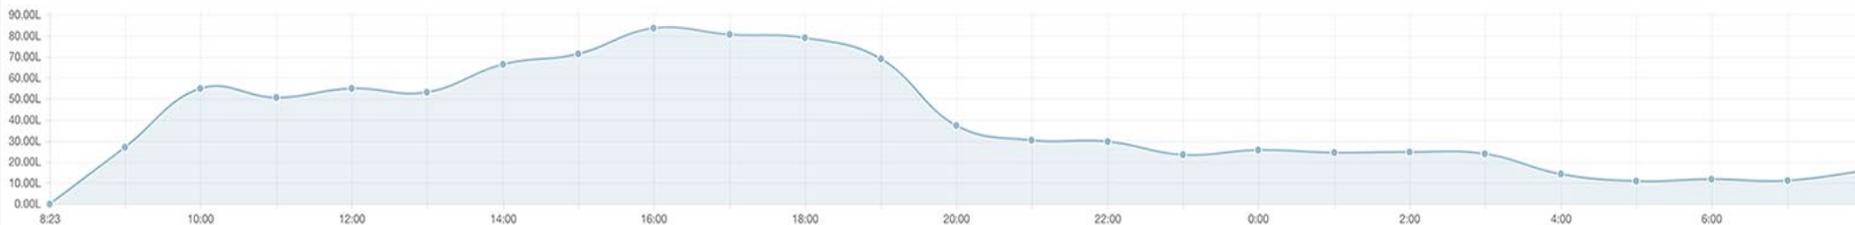

Comments

 Display this treatment (?)

Export CSV

Export PDF

Print



Month Week Day

Sat

1

8

15

22

Click SmartDosing to display the information for the selected treatment.

**Treatment monitoring**

Select your SmartDosing Month Week Day

**Treatments**

- Vaccination
- Medication
- Acidification
- Other treatment
- Rinse
- Sanitation
- Trial

Animals treated: porcine Farmer reference: [ ]

Animal treated: [ ]

Treatment: [ ]

SmartDosing M16260003 pig

Treatment start: 05/09/2018 - 08:06:00 Treatment end: 06/09/2018 - 07:50:00 Duration: 23:44:00

Drinking water volume: 979.65L Volume of injected treatment: 48.98L Dosing rate: 5%

Stop reason: Empty Container Temperature range: 20°C - 20°C

Drinking water volume during the treatment 60 minutes ▾ [ ] [ ]

Comments [ ]

Display this treatment (?) Export

Click Treatment  
and Treated  
Animals.

You can also add information about the treated animals and the administered treatment.

- Treatments
- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

Animals treated: porcine | Farmer reference: [ ]

Animals treated


Batch No./Group No.	[ ] ✓ ✕	Treated rooms	N1 ;N2 ;N3 ;N4	Number of animals	[ ] ✓ ✕
Average weight of an animal (in kg)	[ ] ✓ ✕				

Treatment

Name	[ ] ✓ ✕	Reason for treatment	[ ] ✓ ✕	Dosage	[ ] ✓ ✕
Treatment duration (days)	[ ] ✓ ✕	Waiting time (days)	[ ] ✓ ✕		


SmartDosing M16260003 pig

🕒 Treatment start	05/09/2018 - 08:06:00	🕒 Treatment end	06/09/2018 - 07:50:00	Duration	23:44:00
💧 Drinking water volume	979.65L	🧪 Volume of injected treatment	48.98L	Dosing rate	5%
✕ Stop reason	Empty Container	🌡️ Temperature range	20°C - 20°C		

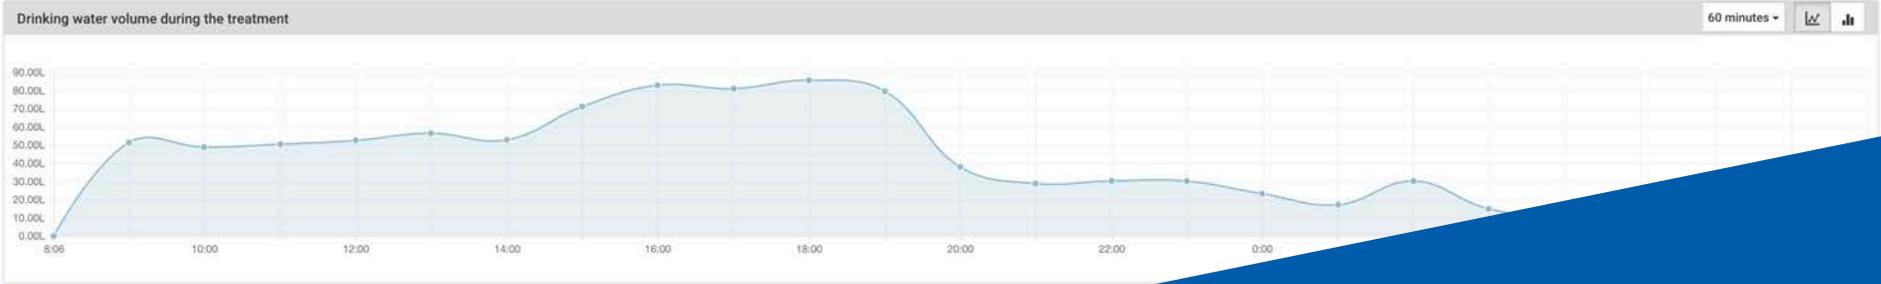

Comments

🔴 Display this treatment (?)

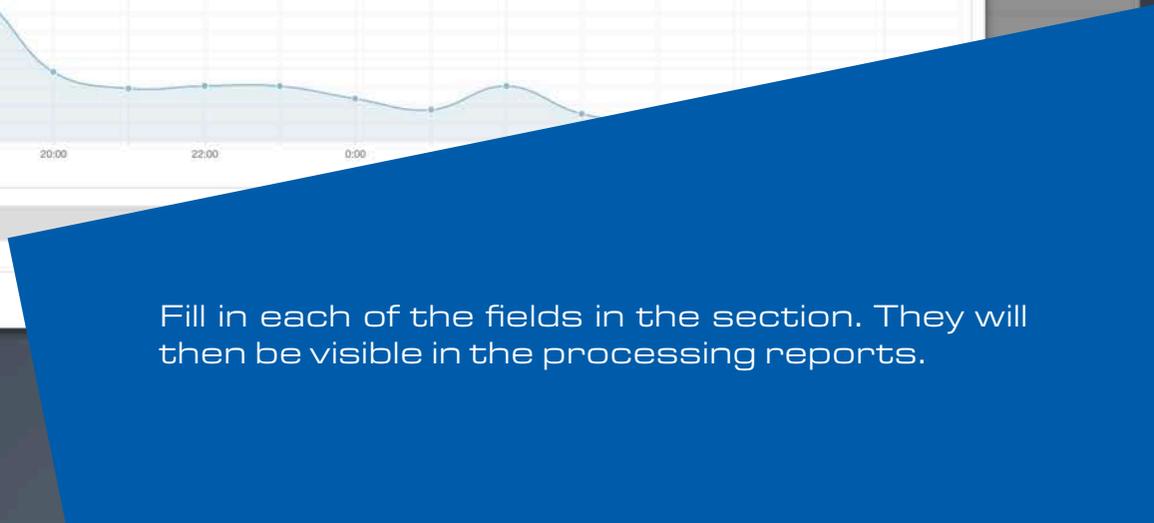

Fill in each of the fields in the section. They will then be visible in the processing reports.

**Treatment monitoring**

Medication

Animals treated porcine Farmer reference

Animals treated

Batch No./Group No. Treated rooms N1,N2,N3,N4 Number of animals

Average weight of an animal (in kg)

Treatment

Name Reason for treatment Dosage

Treatment duration (days) Waiting time (days)

SmartDosing M16260003 pig

Treatment start 05/09/2018 - 08:06:00 Treatment end 06/09/2018 - 07:50:00 Duration 23:44:00

Drinking water volume 979.65L Volume of injected treatment 48.98L Dosing rate 5%

Stop reason Empty Container Temperature range 20°C

Drinking water volume during the treatment

Comments

Display this treatment (?)

Month Week Day

Sat

1

8

15

22

29

36

43

50

57

64

71

78

85

92

99

106

113

120

127

134

141

148

155

162

169

176

183

190

197

204

211

218

225

232

239

246

253

260

267

274

281

288

295

302

309

316

323

330

337

344

351

358

365

372

379

386

393

400

407

414

421

428

435

442

449

456

463

470

477

484

491

498

505

512

519

526

533

540

547

554

561

568

575

582

589

596

603

610

617

624

631

638

645

652

659

666

673

680

687

694

701

708

715

722

729

736

743

750

757

764

771

778

785

792

799

806

813

820

827

834

841

848

855

862

869

876

883

890

897

904

911

918

925

932

939

946

953

960

967

974

981

988

995

1002

1009

1016

1023

1030

1037

1044

1051

1058

1065

1072

1079

1086

1093

1100

1107

1114

1121

1128

1135

1142

1149

1156

1163

1170

1177

1184

1191

1198

1205

1212

1219

1226

1233

1240

1247

1254

1261

1268

1275

1282

1289

1296

1303

1310

1317

1324

1331

1338

1345

1352

1359

1366

1373

1380

1387

1394

1401

1408

1415

1422

1429

1436

1443

1450

1457

1464

1471

1478

1485

1492

1499

1506

1513

1520

1527

1534

1541

1548

1555

1562

1569

1576

1583

1590

1597

1604

1611

1618

1625

1632

1639

1646

1653

1660

1667

1674

1681

1688

1695

1702

1709

1716

1723

1730

1737

1744

1751

1758

1765

1772

1779

1786

1793

1800

1807

1814

1821

1828

1835

1842

1849

1856

1863

1870

1877

1884

1891

1898

1905

1912

1919

1926

1933

1940

1947

1954

1961

1968

1975

1982

1989

1996

2003

2010

2017

2024

2031

2038

2045

2052

2059

2066

2073

2080

2087

2094

2101

2108

2115

2122

2129

2136

2143

2150

2157

2164

2171

2178

2185

2192

2199

2206

2213

2220

2227

2234

2241

2248

2255

2262

2269

2276

2283

2290

2297

2304

2311

2318

2325

2332

2339

2346

2353

2360

2367

2374

2381

2388

2395

2402

2409

2416

2423

2430

2437

2444

2451

2458

2465

2472

2479

2486

2493

2500

2507

2514

2521

2528

2535

2542

2549

2556

2563

2570

2577

2584

2591

2598

2605

2612

2619

2626

2633

2640

2647

2654

2661

2668

2675

2682

2689

2696

2703

2710

2717

2724

2731

2738

2745

2752

2759

2766

2773

2780

2787

2794

2801

2808

2815

2822

2829

2836

2843

2850

2857

2864

2871

2878

2885

2892

2899

2906

2913

2920

2927

2934

2941

2948

2955

2962

2969

2976

2983

2990

2997

3004

3011

3018

3025

3032

3039

3046

3053

3060

3067

3074

3081

3088

3095

3102

3109

3116

3123

3130

3137

3144

3151

3158

3165

3172

3179

3186

3193

3200

3207

3214

3221

3228

3235

3242

3249

3256

3263

3270

3277

3284

3291

3298

3305

3312

3319

3326

3333

3340

3347

3354

3361

3368

3375

3382

3389

3396

3403

3410

3417

3424

3431

3438

3445

3452

3459

3466

3473

3480

3487

3494

3501

3508

3515

3522

3529

3536

3543

3550

3557

3564

3571

3578

3585

3592

3599

3606

3613

3620

3627

3634

3641

3648

3655

3662

3669

3676

3683

3690

3697

3704

3711

3718

3725

3732

3739

3746

3753

3760

3767

3774

3781

3788

3795

3802

3809

3816

3823

3830

3837

3844

3851

3858

3865

3872

3879

3886

3893

3900

3907

3914

3921

3928

3935

3942

3949

3956

3963

3970

3977

3984

3991

3998

4005

4012

4019

4026

4033

4040

4047

4054

4061

4068

4075

4082

4089

4096

4103

4110

4117

4124

4131

4138

4145

4152

4159

4166

4173

4180

4187

4194

4201

4208

4215

4222

4229

4236

4243

4250

4257

4264

4271

4278

4285

4292

4299

4306

4313

4320

4327

4334

4341

4348

4355

4362

4369

4376

4383

4390

4397

4404

4411

4418

4425

4432

4439

4446

4453

4460

4467

4474

4481

4488

4495

4502

4509

4516

4523

4530

4537

4544

4551

4558

4565

4572

4579

4586

4593

4600

4607

4614

4621

4628

4635

4642

4649

4656

4663

4670

4677

4684

4691

4698

4705

4712

4719

4726

4733

4740

4747

4754

4761

4768

4775

4782

4789

4796

4803

4810

4817

4824

4831

4838

4845

4852

4859

4866

4873

4880

4887

4894

4901

4908

4915

4922

4929

4936

4943

4950

4957

4964

4971

4978

4985

4992

4999

5006

5013

5020

5027

5034

5041

5048

5055

5062

5069

5076

5083

5090

5097

5104

5111

5118

5125

5132

5139

5146

5153

5160

5167

5174

5181

5188

5195

5202

5209

5216

5223

5230

5237

5244

5251

5258

5265

5272

5279

5286

5293

5300

5307

5314

5321

5328

5335

5342

5349

5356

5363

5370

5377

5384

5391

5398

5405

5412

5419

5426

5433

5440

5447

5454

5461

5468

5475

5482

5489

5496

5503

5510

5517

5524

5531

5538

5545

5552

5559

5566

5573

5580

5587

5594

5601

5608

5615

5622

5629

5636

5643

5650

5657

5664

5671

5678

5685

5692

5699

5706

5713

5720

5727

5734

5741

5748

5755

5762

5769

5776

5783

5790

5797

5804

5811

5818

5825

5832

5839

5846

5853

5860

5867

5874

5881

5888

5895

5902

5909

5916

5923

5930

5937

5944

5951

5958

5965

5972

5979

5986

5993

6000

6007

6014

6021

6028

6035

6042

6049

6056

6063

6070

6077

6084

6091

6098

6105

6112

6119

6126

6133

6140

6147

6154

6161

6168

6175

6182

6189

6196

6203

6210

6217

6224

6231

6238

6245

6252

6259

6266

6273

6280

6287

6294

6301

6308

6315

6322

6329

6336

6343

6350

6357

6364

6371

6378

6385

6392

6399

6406

6413

6420

6427

6434

6441

6448

6455

6462

6469

6476

6483

6490

6497

6504

6511

6518

6525

6532

6539

6546

6553

6560

6567

6574

6581

6588

6595

6602

6609

6616

6623

6630

6637

6644

6651

6658

6665

6672

6679

6686

6693

6700

6707

6714

6721

6728

6735

6742

6749

6756

6763

6770

6777

6784

6791

6798

6805

6812

6819

6826

6833

6840

6847

6854

6861

6868

6875

6882

6889

6896

6903

6910

6917

6924

6931

6938

6945

6952

6959

6966

6973

6980

6987

6994

7001

7008

7015

7022

7029

7036

7043

7050

7057

7064

7071

7078

7085

7092

7099

7106

7113

7120

7127

7134

7141

7148

7155

7162

7169

7176

7183

7190

7197

7204

7211

7218

7225

7232

7239

7246

7253

7260

7267

7274

7281

7288

7295

7302

7309

7316

7323

7330

7337

7344

7351

7358

7365

7372

7379

7386

7393

7400

7407

7414

7421

7428

7435

7442

7449

7456

7463

7470

7477

7484

7491

7498

7505

7512

7519

7526

7533

7540

7547

7554

7561

7568

7575

7582

7589

7596

7603

7610

7617

7624

7631

7638

7645

7652

7659

7666

7673

7680

7687

7694

7701

7708

7715

7722

7729

7736

7743

7750

7757

7764

7771

7778

7785

7792

7799

7806

7813

7820

7827

7834

7841

7848

7855

7862

7869

7876

7883

7890

7897

7904

7911

7918

7925

7932

7939

7946

7953

7960

7967

7974

7981

7988

7995

8002

8009

8016

8023

8030

8037

8044

8051

8058

8065

8072

8079

8086

8093

8100

8107

8114

8121

8128

8135

8142

8149

8156

8163

8170

8177

8184

8191

8198

8205

8212

8219

8226

8233

8240

8247

8254

8261

8268

8275

8282

8289

8296

8303

8310

8317

8324

8331

8338

8345

8352

8359

8366

8373

8380

8387

8394

8401

8408

8415

8422

8429

8436

8443

8450

8457

8464

8471

8478

8485

8492

8499

8506

8513

8520

8527

8534

8541

8548

8555

8562

8569

8576

8583

8590

8597

8604

8611

8618

8625

8632

8639

8646

8653

8660

8667

8674

8681

8688

8695

8702

8709

8716

8723

8730

8737

8744

8751

8758

8765

8772

8779

8786

8793

8800

8807

8814

8821

8828

8835

8842

8849

8856

8863

8870

8877

8884

8891

8898

8905

8912

8919

8926

8933

8940

8947

8954

8961

8968

8975

8982

8989

8996

9003

9010

9017

9024

9031

9038

9045

9052

9059

9066

9073

9080

9087

9094

9101

9108

9115

9122

9129

9136

9143

9150

9157

9164

9171

9178

9185

9192

9199

9206

9213

9220

9227

9234

9241

9248

9255

9262

9269

9276

9283

9290

9297

9304

9311

9318

9325

9332

9339

9346

9353

9360

Treatments

- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

Animals treated: porcine Farmer reference: [ ]

Animals treated: [ ]

Batch No./Group No. [ ] ✓ ✕ Treated rooms: N1 ;N2 ;N3 ;N4 Number of animals [ ] ✓ ✕

Average weight of an animal (in kg) [ ] ✓ ✕


Treatment: [ ]

Name [ ] ✓ ✕ Reason for treatment [ ] ✓ ✕ Dosage [ ] [ ]

Treatment duration (days) [ ] ✓ ✕ Waiting time (days) [ ] ✓ ✕


SmartDosing M16260003 pig

Drinking water volume during the treatment

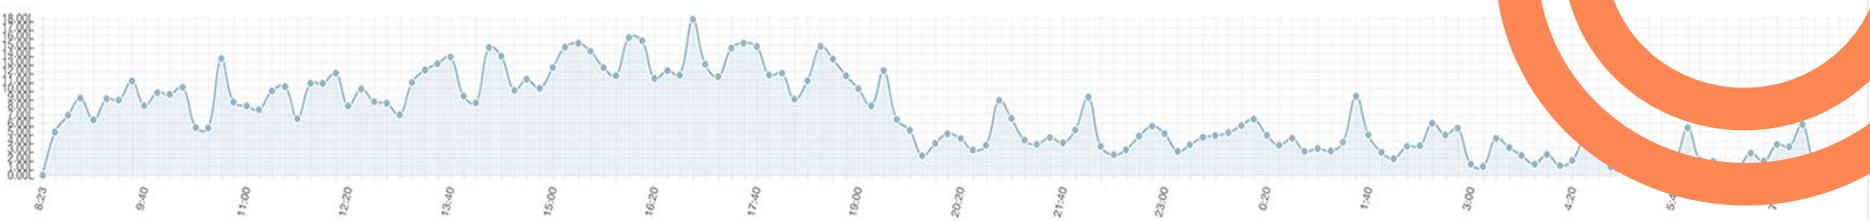

Comments

Display this treatment (?)

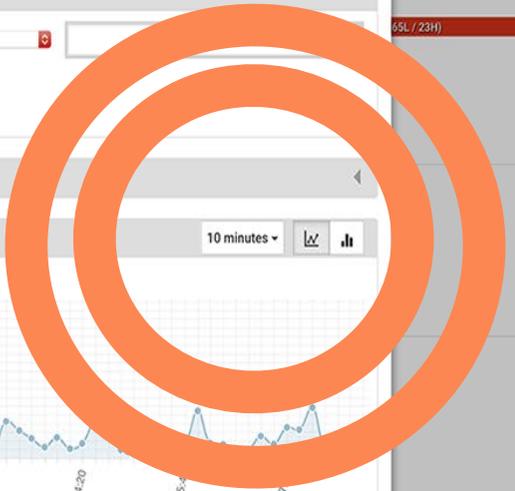

The curve is more precise.

ADVANCED SEARCH





- Dashboard
- Dosing pump monitoring
- Treatment monitoring
- Advanced search
- Data import (USB)
- Your SmartDosing
- Configuration

- Calculators
- Poultry medication calculator
  - Pig medication calculator
- About  
End-User Licence Agreement

© DOSATRON INTERNATIONAL S.A.S 2019 Dosatron



2018/03/10
21 days 02:41:01
5998.69L
529.99L
20°C - 20°C
2018/04/03
M25AL5 V2.9.4.4

5 latest alarms

- No water supply 2018/08/27

5 latest events

- Diagnosis 2018/09/10
- Preventive maintenance 2018/09/09

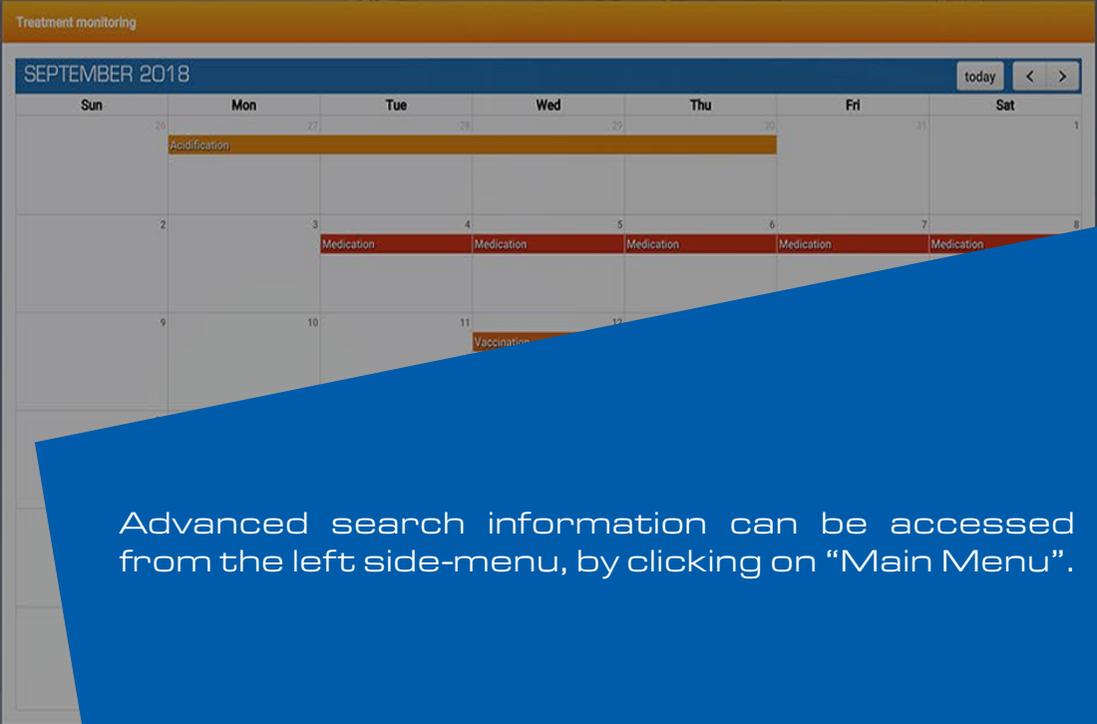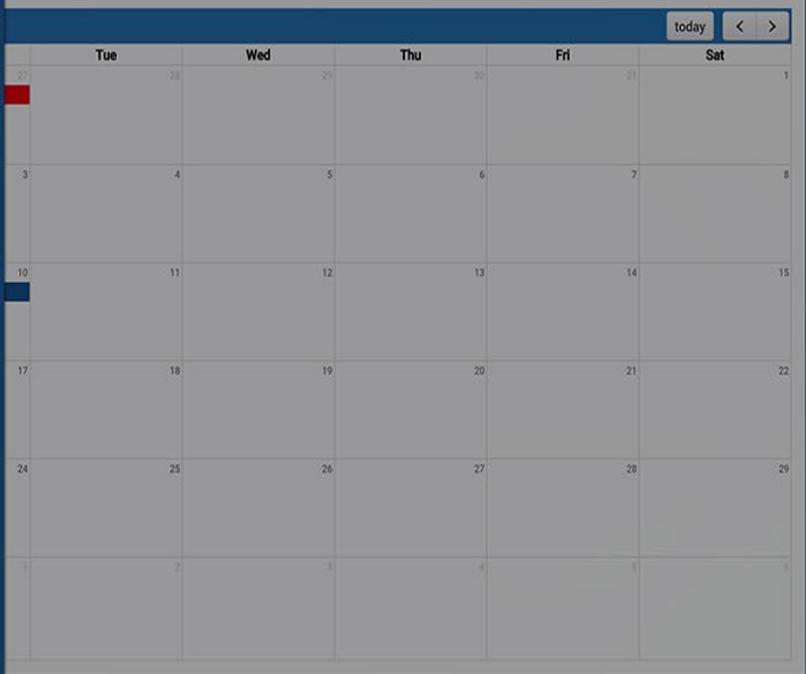

Advanced search information can be accessed from the left side-menu, by clicking on "Main Menu".

September 2018

today &lt; &gt; Month Week Day

	Sun	Mon	Tue	Wed	Thu	Fri	Sat
		26	27	28	29	30	31
Dashboard		08:32 Acidification (5116.11L / 90H)					
Dosing pump monitoring							
Treatment monitoring							
Advanced search	2	3	4	5	6	7	8
Data import (USB)		08:23 Medication (973.76L / 23H)		08:06 Medication (979.65L / 23H)	08:10 Medication (1039.19L / 24H)	08:23 Medication (973.76L / 23H)	08:06 Medication (979.65L / 23H)
Your SmartDosing							
Configuration							
Calculators	9	10	11	12	13	14	15
Poultry medication calculator			13:15 Vaccination (537.65L / 5H)				
Pig medication calculator							
About	16	17	18	19	20	21	22
End-User Licence Agreement							
© DOSATRON INTERNATIONAL S.A.S 2019 Dosatron	23	24	25	26	27	28	29
		1	2	3	4	5	6

Select "Advanced search".

Advanced search

Available pumps (Check all / Uncheck all): Réinitialiser le formulaire

porc (M16260003 pig)  dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

Rooms/Circuits/Boxes

Treatment

Vaccination  
 Medication  
 Acidification  
 Other treatments  
 Rinse  
 Sanitation  
 Trial

No result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
No result							

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all):

Réinitialiser le formulaire

- porc (M16260003 pig)
- dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

porc	<input type="checkbox"/> <input type="checkbox"/>
dinde	<input type="checkbox"/> <input type="checkbox"/>

Rooms/Circuits/Boxes

porc	<input type="checkbox"/> <input type="checkbox"/>
<input type="checkbox"/> PS1	
<input type="checkbox"/> PS2	
<input type="checkbox"/> PS3	
<input type="checkbox"/> PS4	
<input type="checkbox"/> PS5	
<input type="checkbox"/> N1	
<input type="checkbox"/> N2	
<input type="checkbox"/> N3	

Treatment

<input checked="" type="checkbox"/> Vaccination
<input type="checkbox"/> Medication
<input type="checkbox"/> Acidification
<input type="checkbox"/> Other treatments
<input type="checkbox"/> Rinse
<input type="checkbox"/> Sanitation
<input type="checkbox"/> Trial

No result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
No result							

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all):

Réinitialiser le formulaire

- porc (M16260003 pig)
- dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

porc	<input type="checkbox"/> <input type="checkbox"/>
dinde	<input type="checkbox"/> <input type="checkbox"/>

Rooms/Circuits/Boxes

porc	<input type="checkbox"/> <input type="checkbox"/>
<input type="checkbox"/> PS1	
<input type="checkbox"/> PS2	
<input type="checkbox"/> PS3	
<input type="checkbox"/> PS4	
<input type="checkbox"/> PS5	
<input type="checkbox"/> N1	
<input type="checkbox"/> N2	
<input type="checkbox"/> N3	

Treatment

<input checked="" type="checkbox"/> Vaccination
<input checked="" type="checkbox"/> Medication
<input type="checkbox"/> Acidification
<input type="checkbox"/> Other treatments
<input type="checkbox"/> Rinse
<input type="checkbox"/> Sanitation
<input type="checkbox"/> Trial

No result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
No result							

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all): Réinitialiser le formulaire

porc (M16260003 pig)  dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

Rooms/Circuits/Boxes

Treatment

Vaccination  
 Medication  
 Acidification  
 Other treatments  
 Rinse  
 Sanitation  
 Trial

1 result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3, PS4, PS5, N1, N2, N3

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all):

porc (M16260003 pig)  dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

Rooms/Circuits/Boxes

Treatment

Vaccination  
 Medication  
 Acidification  
 Other treatments  
 Rinse  
 Sanitation  
 Trial

Réinitialiser le formulaire

1 result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3, PS4, PS5, N1, N2, N3

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all): Réinitialiser le formulaire

porc (M16260003 pig)  dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.  Rooms/Circuits/Boxes  Treatment

porc

dinde

porc

PS1  
 PS2  
 PS3  
 PS4  
 PS5  
 N1  
 N2  
 N3

Vaccination  
 Medication  
 Acidification  
 Other treatments  
 Rinse  
 Sanitation  
 Trial

1 result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3

Select the data you want to review in order to display the treatments related to this data.

Advanced search

Available pumps (Check all / Uncheck all): Réinitialiser le formulaire

porc (M16260003 pig)  dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

Rooms/Circuits/Boxes

Treatment

Vaccination  
 Medication  
 Acidification  
 Other treatments  
 Rinse  
 Sanitation  
 Trial

1 result for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3, PS4, PS5, N1, N2, N3

Select the data you want to review in order to display the treatments related to this data.

Réinitialiser le formulaire

Once all the elements have been chosen and selected, click on the "Export" button.

Batch No./Group No.

porc

dlinde

porc

- PS1
- PS2
- PS3
- PS4
- PS5
- N1
- N2
- N3

Treatment

- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

6 results for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes	Include (?)
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3, PS4, PS5	<input checked="" type="checkbox"/>
porc	Medication			2018/09/08	23:44:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
porc	Medication			2018/09/07	23:27:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
porc	Medication			2018/09/06	01 days 00:07:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
porc	Medication			2018/09/05	23:44:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
porc	Medication			2018/09/04	23:27:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>

Export checked elements

Data export

All treatments have been selected to be exported.

Select data to include in the export:

- Consumption data
- Graphs
- Alarms

Export data to CSV   Export data to PDF   Print data   Close

Réinitialiser le formulaire

Advanced search

Available pumps (Check all / Uncheck all):

- porc (M16260003 pig)
- dinde (M16260004 poultry)

Date range: From   Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.



- porc
- dinde

Rooms/Circuits/Boxes



- porc
- PS1
- PS2
- PS3
- PS4
- PS5
- N1
- N2
- N3

Treatment



- Vaccination
- Medication
- Acidification
- Other treatments
- Rinse
- Sanitation
- Trial

6 results for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2
porc	Medication			2018/09/08	23:44:00		
porc	Medication			2018/09/07	23:27:00		
porc	Medication			2018/09/06	01 days 00:00:00		
porc	Medication			2018/09/05			
porc	Medication			2018/09/04			

You can export the results in the form of graphs, data, and curve.

Advanced search

Available pumps (Check all / Uncheck all):

porc (M16260003 pig)

dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

porc	<input type="checkbox"/> <input type="checkbox"/>
dinde	<input type="checkbox"/> <input type="checkbox"/>

Rooms/Circuits/Boxes

porc	<input type="checkbox"/> <input type="checkbox"/>
<input checked="" type="checkbox"/> PS1	
<input checked="" type="checkbox"/> PS2	
<input checked="" type="checkbox"/> PS3	
<input checked="" type="checkbox"/> PS4	
<input type="checkbox"/> PS5	
<input checked="" type="checkbox"/> N1	
<input type="checkbox"/> N2	
<input type="checkbox"/> N3	

Treatment

<input checked="" type="checkbox"/> Vaccination
<input checked="" type="checkbox"/> Medication
<input type="checkbox"/> Acidification
<input type="checkbox"/> Other treatments
<input type="checkbox"/> Rinse
<input type="checkbox"/> Sanitation
<input type="checkbox"/> Trial

### Data export

A total of 6 treatments have been selected to be exported.

Select data to include in the export:

- Consumption data
- Graphs
- Alarms

6 results for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2
porc	Medication			2018/09/08	23:44:00		PS1, PS2
porc	Medication			2018/09/07	23:27:00		PS1, PS2
porc	Medication			2018/09/06	01 days 00:00:00		PS1, PS2
porc	Medication			2018/09/05			PS1, PS2
porc	Medication			2018/09/04			PS1, PS2

You can save as PDF, export as CSV or print.

Advanced search

Available pumps (Check all / Uncheck all):

porc (M16260003 pig)

dinde (M16260004 poultry)

Date range: From  Until

Display all treatments:  Display hidden treatments

Treatment name (?):

Reason for treatment:

Batch No./Group No.

porc	<input type="checkbox"/> <input type="checkbox"/>
dinde	<input type="checkbox"/> <input type="checkbox"/>

Rooms/Circuits/Boxes

porc	<input type="checkbox"/> <input type="checkbox"/>
<input checked="" type="checkbox"/> PS1	
<input checked="" type="checkbox"/> PS2	
<input checked="" type="checkbox"/> PS3	
<input checked="" type="checkbox"/> PS4	
<input type="checkbox"/> PS5	
<input checked="" type="checkbox"/> N1	
<input type="checkbox"/> N2	
<input type="checkbox"/> N3	

Treatment

<input checked="" type="checkbox"/> Vaccination
<input checked="" type="checkbox"/> Medication
<input type="checkbox"/> Acidification
<input type="checkbox"/> Other treatments
<input type="checkbox"/> Rinse
<input type="checkbox"/> Sanitation
<input type="checkbox"/> Trial

**Data export**

A total of 6 treatments have been selected to be exported.

Select data to include in the export:

- Consumption data
- Graphs
- Alarms




Réinitialiser le formulaire

6 results for your search

Dosing pump	Treatment	Treatment name	Reason for treatment	Treatment start	Duration	Batch No./Group No.	Rooms/Circuits/Boxes	Include (?)
porc	Vaccination			2018/09/12	05:41:00		PS1, PS2, PS3, PS4, PS5	<input checked="" type="checkbox"/>
porc	Medication			2018/09/08	23:44:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
porc	Medication			2018/09/07	23:27:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
				2018/09/06	01 days 00:07:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
				2018/09/05	23:44:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>
				2018/09/04	23:27:00		N1, N2, N3, N4	<input checked="" type="checkbox"/>

Click on Close.



Now you know how to use your processing data!  
For more information, please refer to the operating instructions  
available on the USB stick or at [www.dosatron.com](http://www.dosatron.com).

To review this tutorial, go to the main menu  
of your SmartLink: Tutorial tab.

